



Pierce Enforcer Pumper
Hamilton Township/Mizpah Fire Company
Job #30639

FEATURES & SPECIFICATIONS


- Pierce Enforcer 60" Chassis with a 10" Raised Roof
- Cummins L9 450 hp 2017 EPA compliant Engine
- Allison EVS3000P Automatic Transmission
- Waterous CSU 1500 GPM Single Stage Pump
- Dana Front and Rear Axles
- 500 Gallon Poly Tank
- Harrison MSV 6kw Hydraulic Generator
- Delivered in June 2017



FIRE & SAFETY SERVICES, LTD.

South Plainfield, NJ

web: www.f-ss.com · phone: 800-400-8017

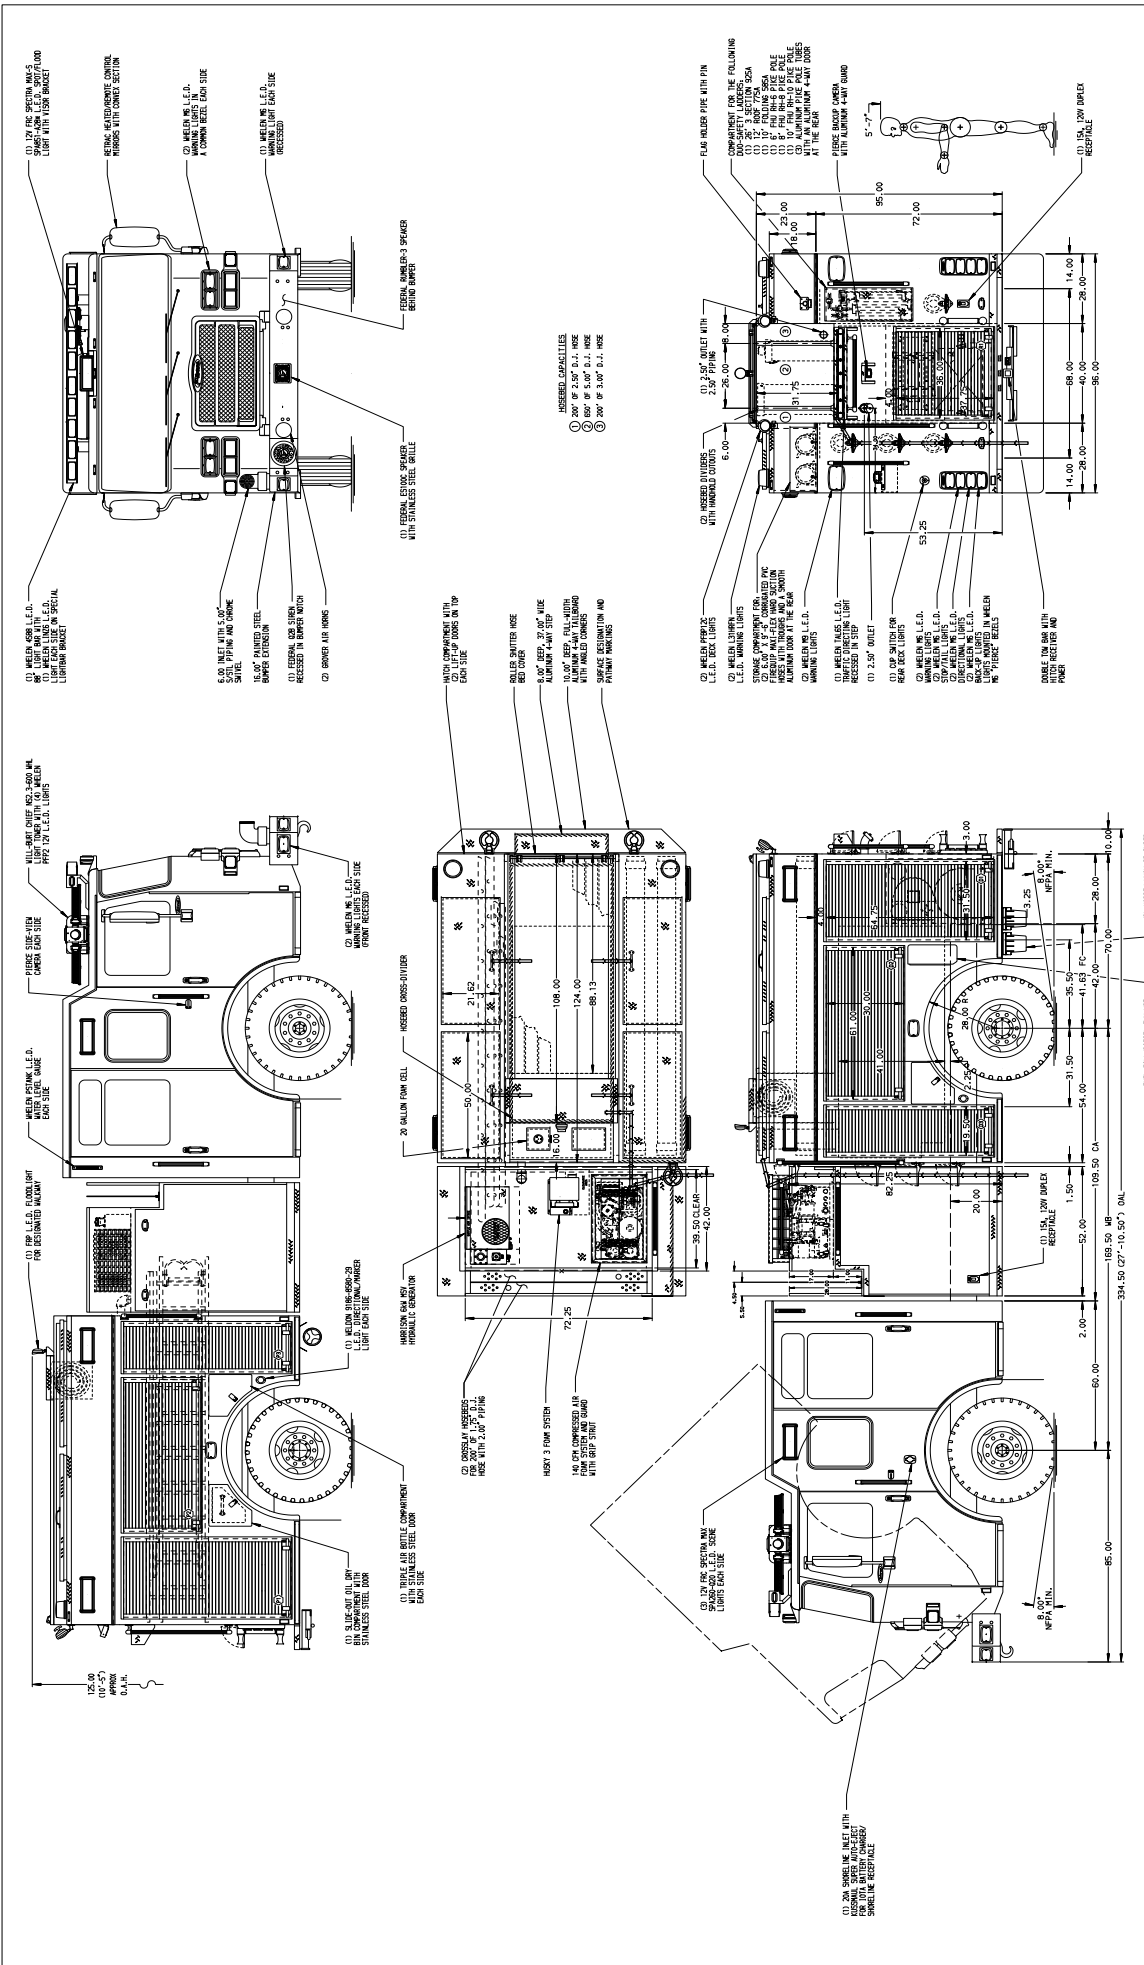

Pierce		MANUFACTURING INC.		JOB NO.	30639
CHASSIS DATA	1500-D-500P W/20 GAL FOAM CELL, 124" RESCUE BODY	SCALE	1:24	DATE	
TITLE	(2) AXLES, LADDERS THRU BODY, GENERATOR, CAFS 140	DRAWN BY	NPA	0400T16	
DATE	FOR HAYS LANDING, NEW JERSEY	CHECKED BY	CSH	0500T16	
REV	DATE	BY	CHK	DWG	SHEET NO.
1					D
					1 OF 1

STAINLESS STEEL BODY

MAXIMUM O.A.L. 334.50"

NOTE:
 DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

1. BATTERY COVER (A) BEING ORDERED SEAT.
2. BATTERY COVER (B) BEING ORDERED SEAT.
3. BATTERY COVER (C) BEING ORDERED SEAT.
4. BATTERY COVER (D) BEING ORDERED SEAT.
5. BATTERY COVER (E) BEING ORDERED SEAT.
6. BATTERY COVER (F) BEING ORDERED SEAT.
7. BATTERY COVER (G) BEING ORDERED SEAT.
8. BATTERY COVER (H) BEING ORDERED SEAT.
9. BATTERY COVER (I) BEING ORDERED SEAT.
10. ONE (1) 12V DC BATTERY (12V 100AH) IN COMPARTMENT B1.
11. TWO (2) 12V DC BATTERIES (12V 100AH) IN COMPARTMENT B2.
12. CLOSET BEHIND PANEL IN COMPARTMENT D1.